

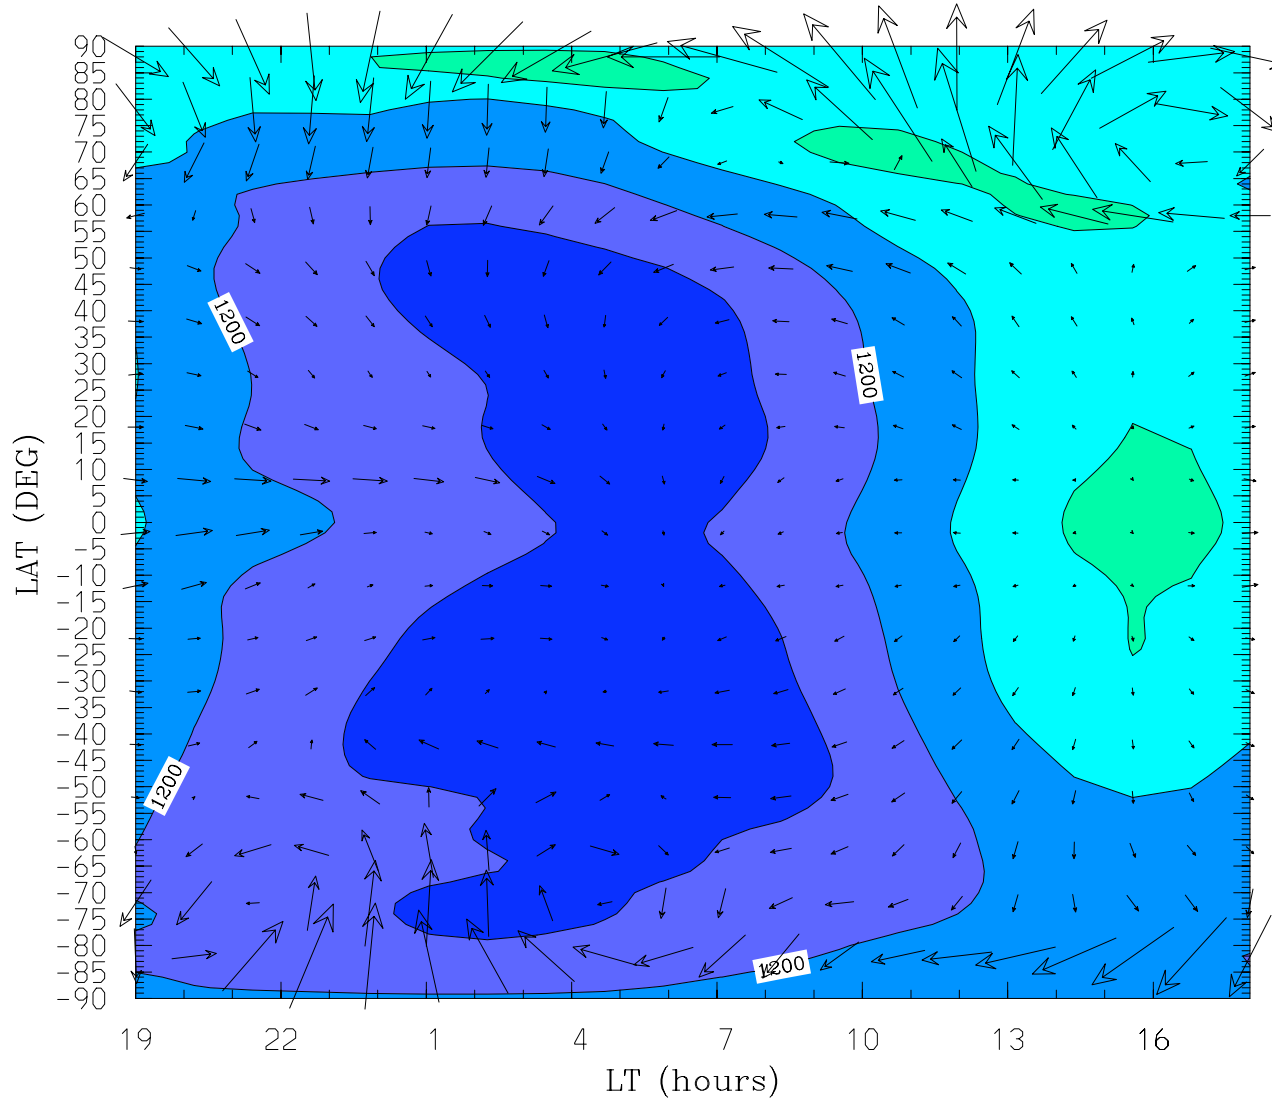


CTIP NEUTRAL TEMPERATURE (DEG. K) rcm033101rlsw1



UT 19.0 Pressure level 12.0  
MINIMUM 1000.3, MAXIMUM 1436.2, CONTOUR INTERVAL 100  
Minimum Vector Maximum Vector



CTIM Height Integrated O/N2 ratio rcm033101rlsw1

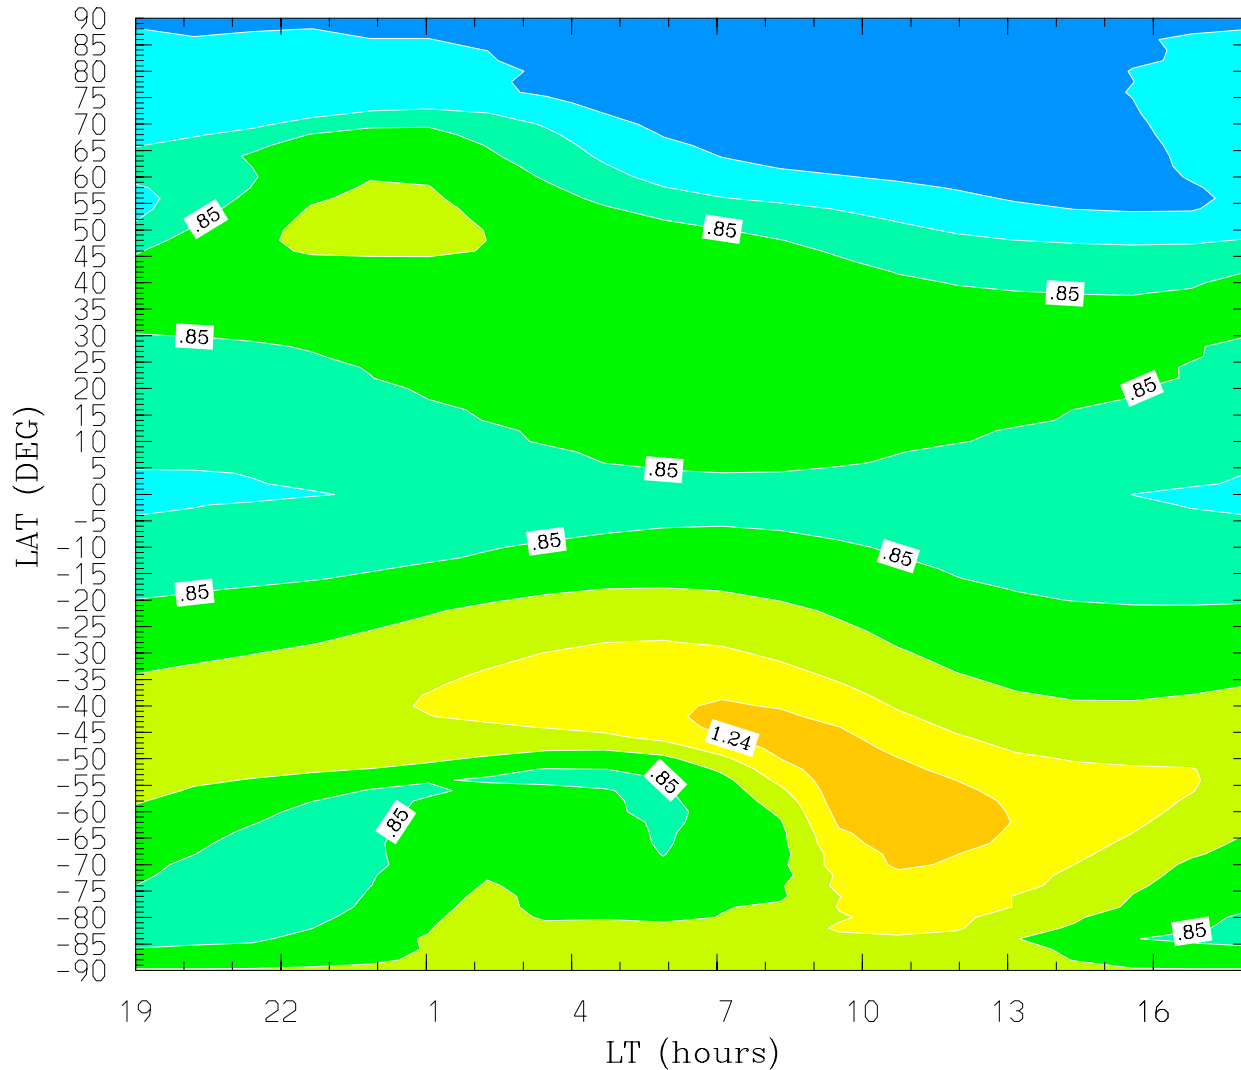

UT 19.0 Pressure level 12.0

MINIMUM .4631, MAXIMUM 1.3153, CONTOUR INTERVAL .13



CTIP [Ne] Number Density (m<sup>-3</sup>) rcm033101rlsw1

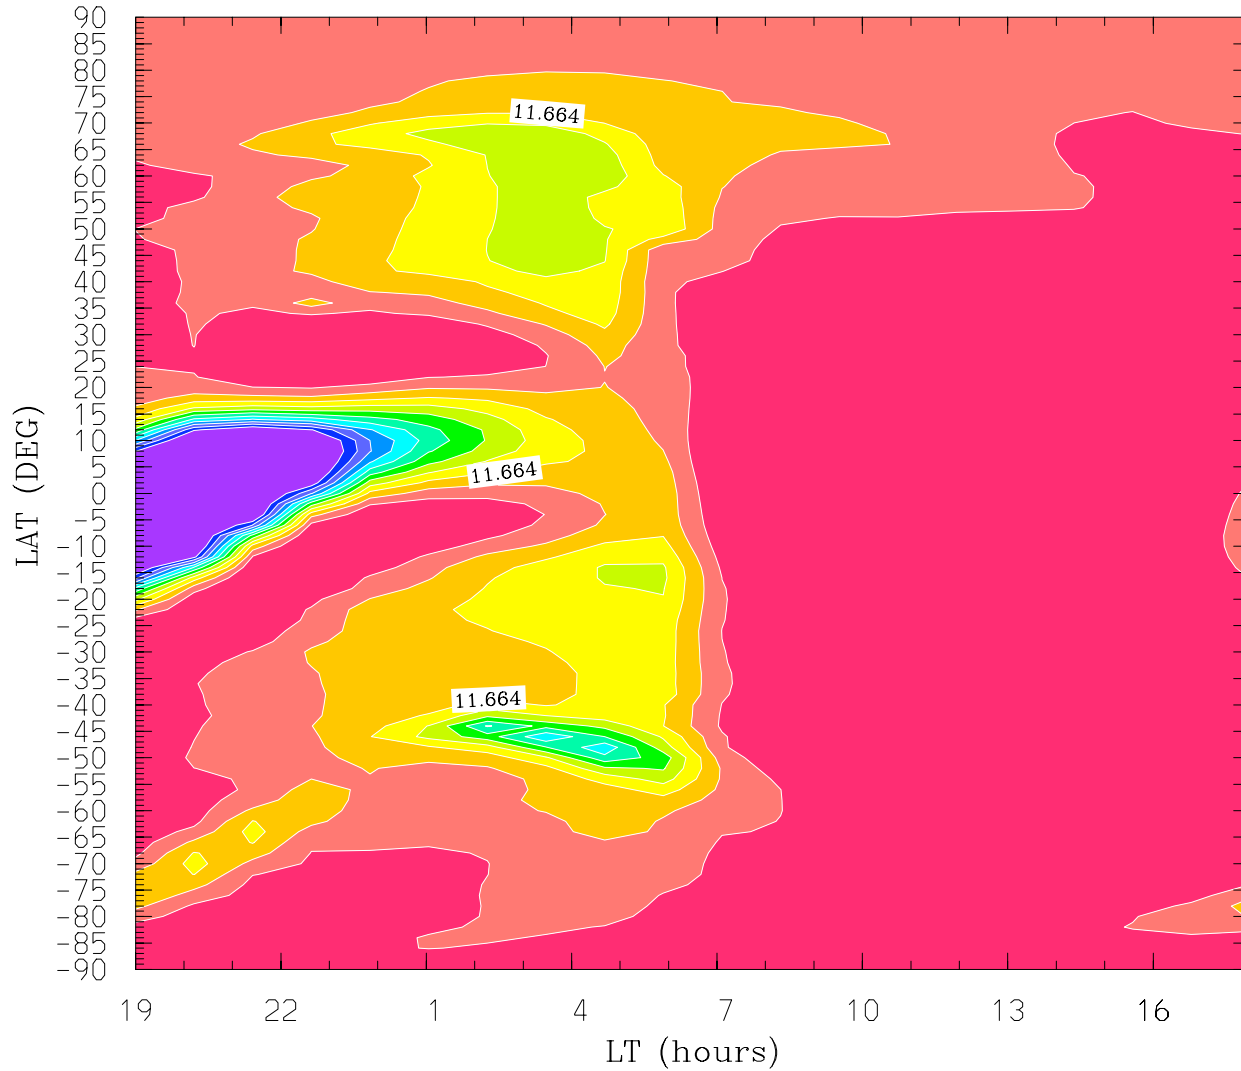

UT 19.0 Pressure level 12.0

MINIMUM 9.876, MAXIMUM 12.405, CONTOUR INTERVAL .168

CTIP Mean molec. mass (amu) rcm033101rlsw1

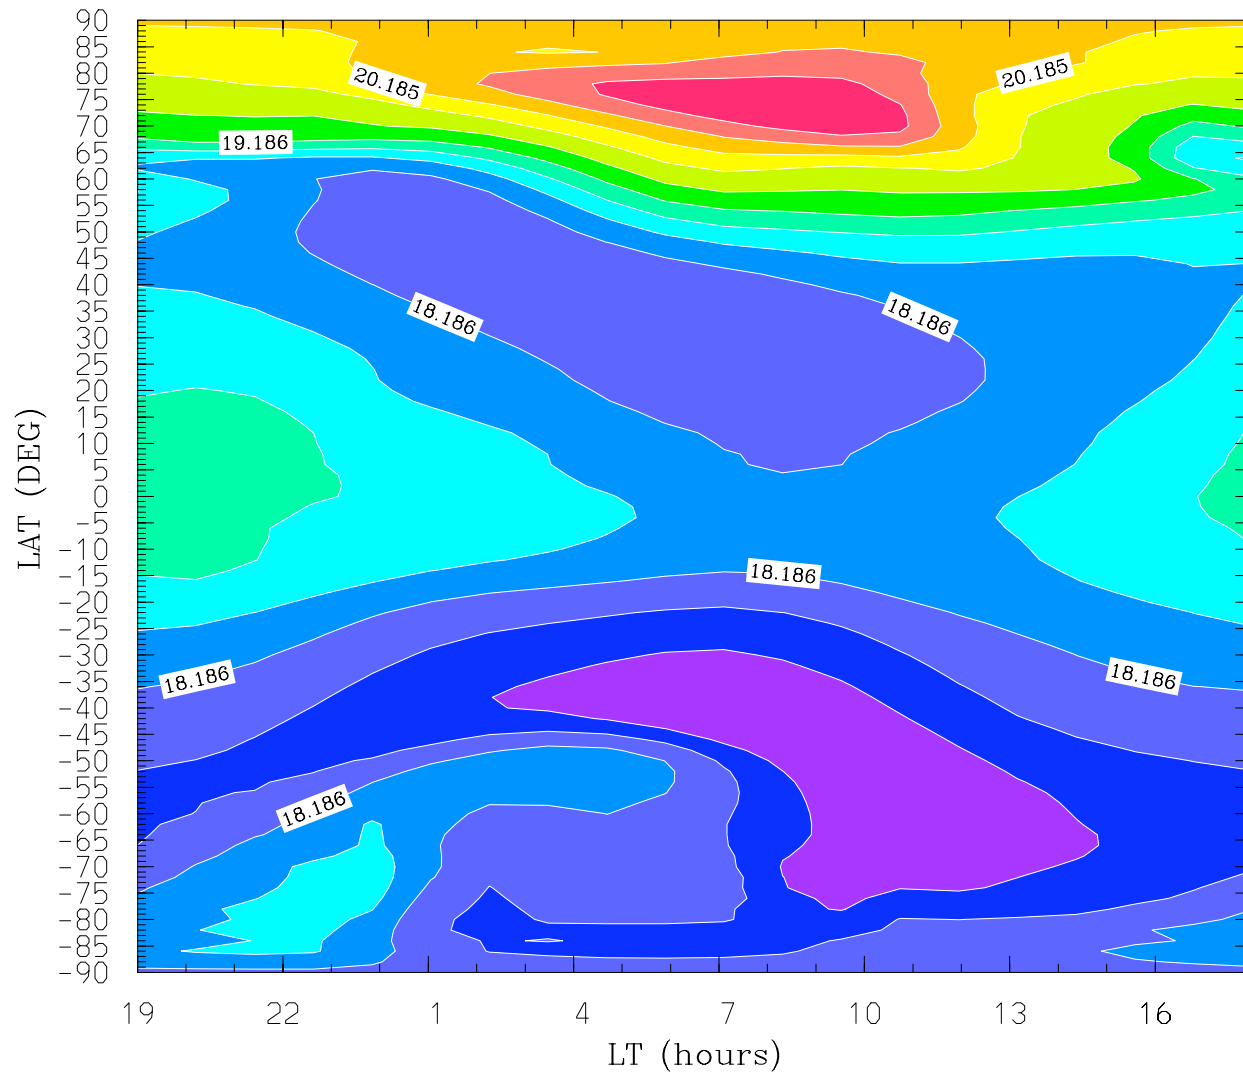



UT 19.0 Pressure level 12.0

MINIMUM 17.187, MAXIMUM 21.185, CONTOUR INTERVAL .333

CTIP HmF2 (km)

rcm033101rlsw1

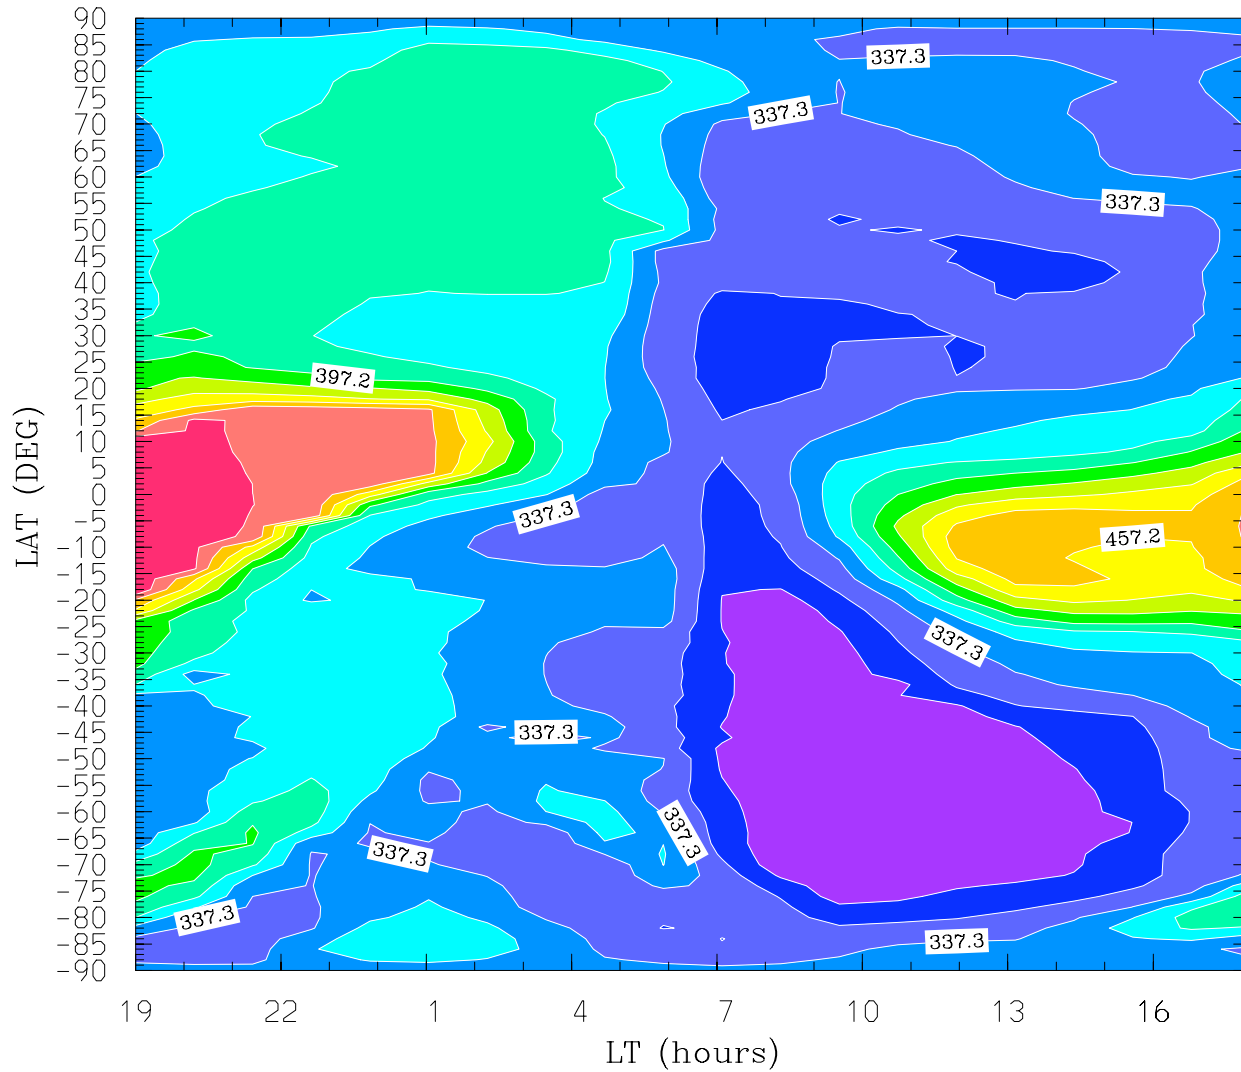


UT 19.0

MINIMUM 277.3, MAXIMUM 517.2, CONTOUR INTERVAL 19.9

CTIP NmF2 (m-3)

rcm033101rlsw1

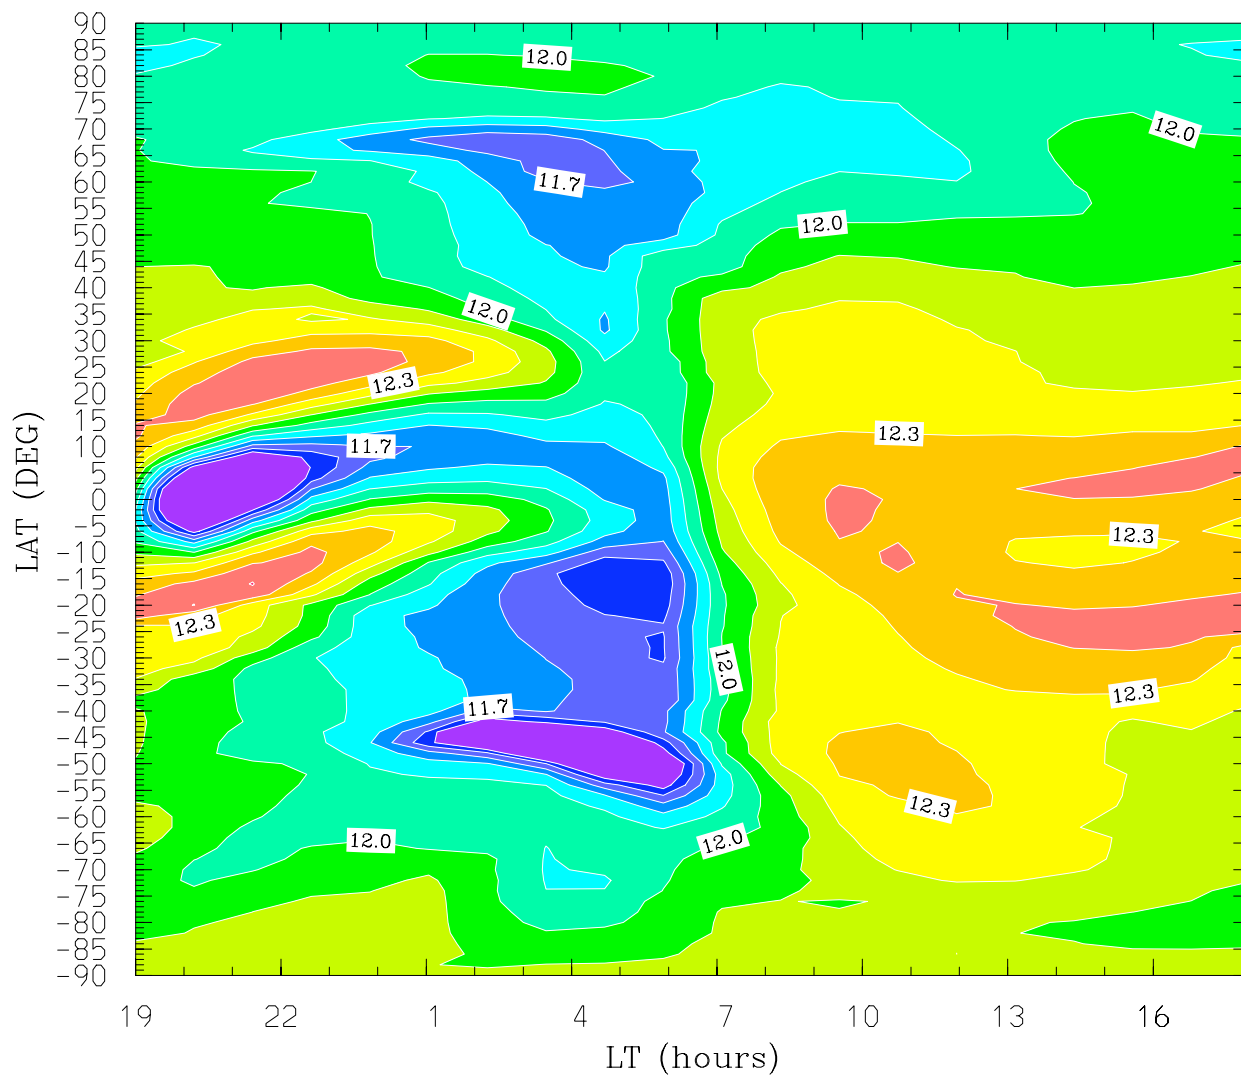

UT 19.0

MINIMUM 10.842, MAXIMUM 12.505, CONTOUR INTERVAL .1